









**Size:** DN 15 to DN100

**Ends:** Between flanges ISO PN40

Min Temperature: -10°C

Max Temperature: +300°C

Max Pressure: 40 Bars

Specifications: Spring type

All positions Metal / metal

Materials: Stainless steel F316 body and disc.

### **SPECIFICATIONS:**


- Spring type
- All positions (respect the flow direction indicated by the arrow )
- Short length
- Full stainless steel corrosion resistant and for high temperature
- Metal / metal tightness

### USE:

- Chemical and pharmaceutical industries, petrochemical industries, hydraulic installation, compressed air, steam
- Min Temperature Ts : 10°C
- Max Temperature Ts :+ 300°C
- Max Pressure Ps : 40 bars ( see graph under )

### PRESSURE / TEMPERATURE GRAPH:



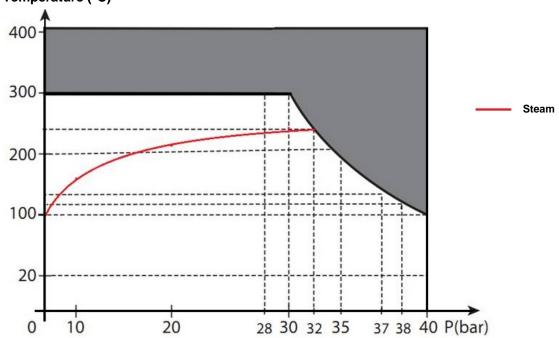


## FLOW COEFFICIENT Kvs (M3/h):

DN	15	20	25	32	40	50	65	80	100
Kvs ( m3/h )	1.2	2.2	3.2	4.8	7.2	11.8	17.8	23.7	39.5

## RANGE:

• Stainless steel wafer spring check valve ISO PN40 Ref. 94387 from DN15 to DN100


### **HEAD LOSS GRAPH:**

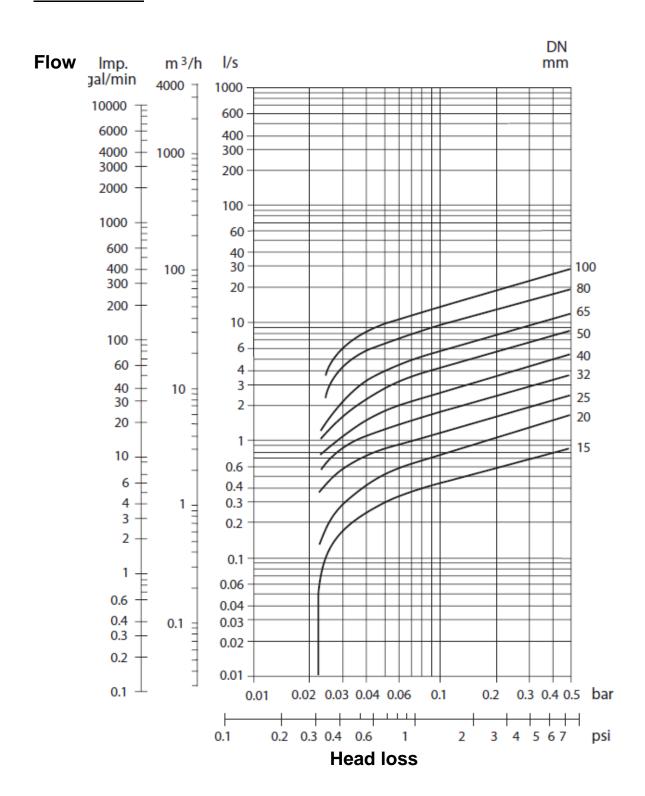

### OPENING PRESSURE ( in mbar ):


DN	Vertical Position Ascendant fluid	Horizontal position ——>
15	25	22.5
20	25	22.5
25	25	22.5
32	27	23.5
40	28	24
50	29	24.5
65	30	25
80	31	25.5
100	33	26.5

### **MATERIALS**:

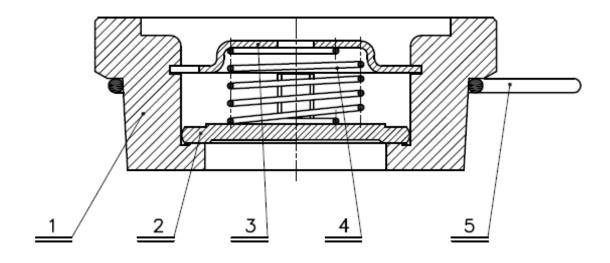

Item	Designation	Materials		
1	Body	SS 316		
2	Disc	SS 316		
3	Spring holder	SS 316		
4	Spring	SS 302		
5	Centering ring	SS 302		

# SIZE ( in mm ):

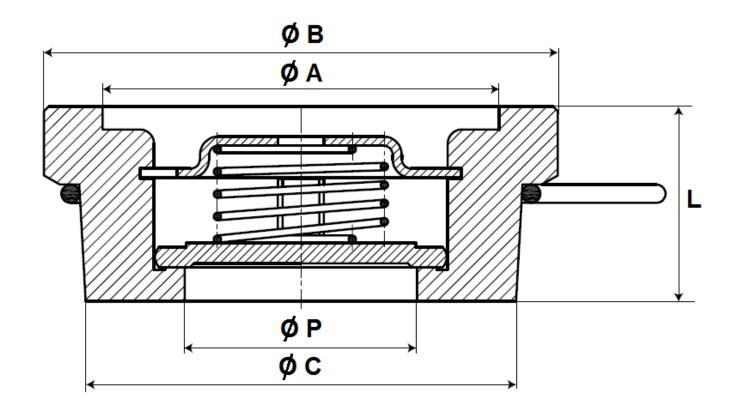

Ref.	DN	15	20	25	32	40	50	65	80	100
387	Ø A	28.3	35.7	43.2	52.4	63.1	75.4	96.2	109	125.3
	ØВ	39	46	54	70	80	96	113	130	150
	øс	33.5	41.2	48.3	62	74.5	87.5	107	126.3	145
	ØΡ	15	20	25.3	31.7	39.3	48	62	75	85
	L	16	19	21	27.2	31	40	46	50	60
	Weight (Kg)	0.100	0.150	0.200	0.350	0.550	0.950	1.250	2.250	3.550


### STANDARDS:

- Fabrication according to ISO 9001 : 2008
- DIRECTIVE 97/23/CE : CE N° 0036 Risk Category II Module A1
- Construction according to EN 12334
- Designing according to EN 14341
- Tests according to EN 12266-1, range A
- Length according to EN 558 series 49


### **INSTALLATION POSITIONS:**

### Vertical position (ascendant fluid)

### vertical position ( ascendant nata )

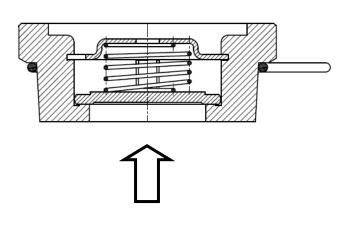

#### **Horizontal position**

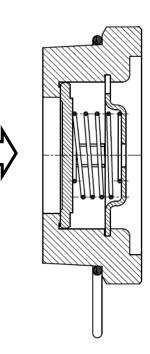

**ADVICE**: Our opinion and our advice are not guaranteed and ADL Appendages shall not be liable for the consequences of damages. The customer must check the right choice of the products with the real service conditions.

## **INSTALLATION INSTRUCTIONS**

#### **GENERAL GUIDELINES:**

- Ensure that the check valves to be used are appropriate for the conditions of the installation (type of fluid, pressure and temperature).
- Be sure to have enough valves to be able to isolate the sections of piping as well as the appropriate equipment for maintenance and repair.
- Ensure that the valves to be installed are of correct strength to be able to support the capacity of their usage.

#### **INSTALLATION INSTRUCTIONS:**

- Before installing the check valves, clean and remove any objects from the pipes (in particular bits of sealing and metal) which could obstruct and block the valves.
- Ensure that both connecting pipes either side of the check valve (upstream and downstream) are aligned (if they're not, the valves may not work correctly).
- Make sure that the two sections of the pipe (upstream and downstream) match, the check valve unit
  will not absorb any gaps. Any distortions in the pipes may affect the thightness of the
  connection, the working of the check valve and can even cause a rupture. To be sure, place the kit in
  position to ensure the assembling will work.
- Make sure there is enough space so that the disc can be opened totally in the pipe.
- If there is a direction changing or if there's another material, it's better to take away the check valve so that it is outside the turbulence area ( **between 3 and 5 times the ND before and after** ).
- After a pump please refer to norm NF CR 13932 to install the check valve.